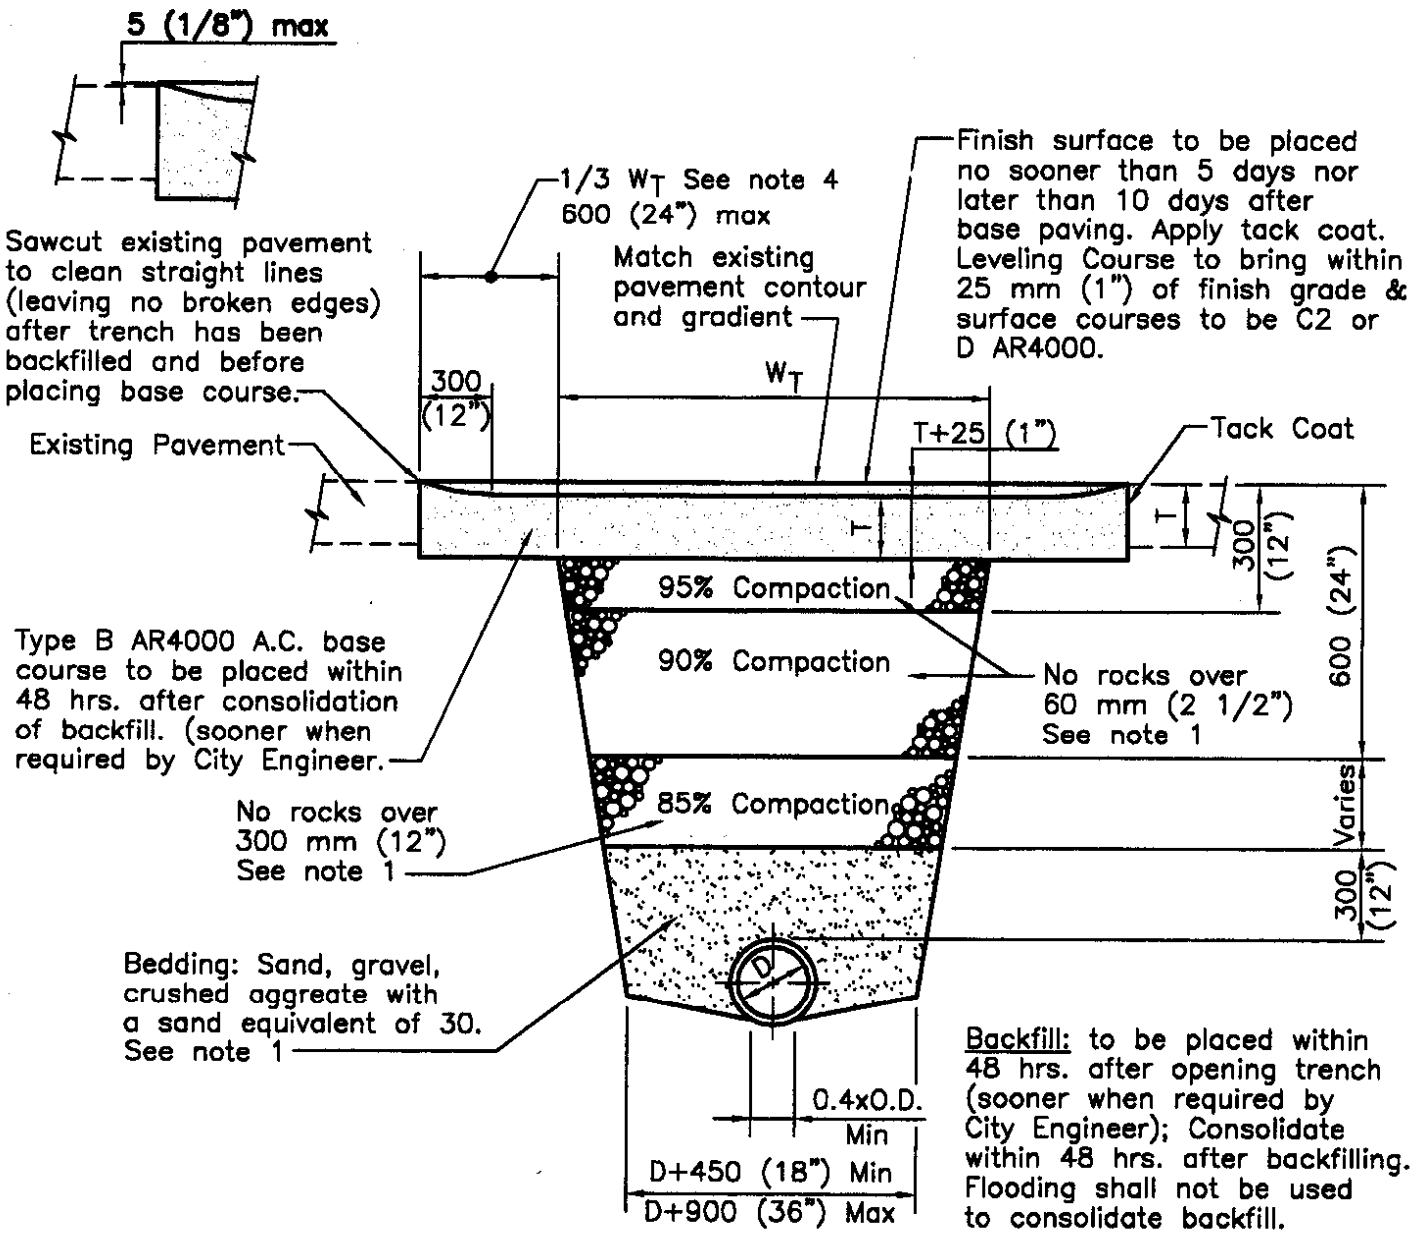

DETAIL FOR TRENCHING, BACKFILL & A.C. PAVEMENT REPAIR

NOTES:

1. Backfill for trenches with W =900 mm (36") or less shall be cement slurry, class 120-E-1.4 (200-E-200) unless otherwise approved by the City Engineer.
2. Unless otherwise instructed by the City Engineer, trench patch shall not be crowned at center.
3. Temporary asphalt concrete shall be 100 mm (4") minimum thickness. Compaction and surface finish shall equal to that required for permanent asphalt concrete pavement.
4. Outer dimension does not apply to single excavations smaller than 1.5 x 1.5 m (5'x5').
5. Replace obliterated striping within 7 days of permanent paving.

Dimensions are in millimeters, except as noted

REVISIONS		CITY OF LONG BEACH, CALIFORNIA DEPARTMENT OF PUBLIC WORKS	STANDARD PLAN NO.
NO.	DATE		
1	04/04/96	TRENCH REQUIREMENTS IN STREETS R/W	METRIC 127
2	11/24/97		
3	12/23/02	APPROVED BY: CITY ENGINEER R.E. No. 40599 DATE: 1/10/03 EX. DATE 03/31/03	SHEET 1 OF 1
4			