


Cover identification:  
STREET LIGHTING  
HIGH VOLTAGE

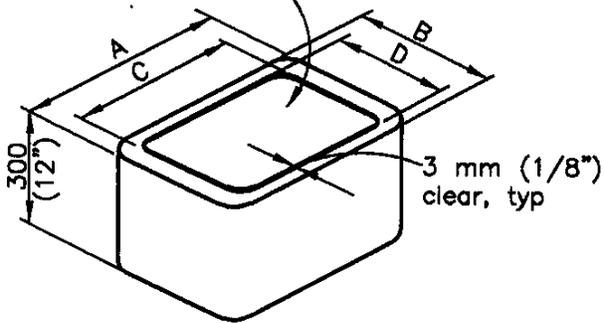


PULL BOX NO.	TYPE	DIMENSIONS			
		Outside		Cover	
		A	B	C	D
5	PCC	635 (25")	380 (15")	550 (21 3/4")	300 (11 3/4")
6	PCC	865 (34")	560 (22")	755 (29 3/4")	450 (17 3/4")

NOTE:


Pull boxes shall be non-boltdown type unless noted.

PULL BOX DETAILS

PCC apron, 75 mm (3") thick around pull box. Delete apron if pull box is constructed within a sidewalk.

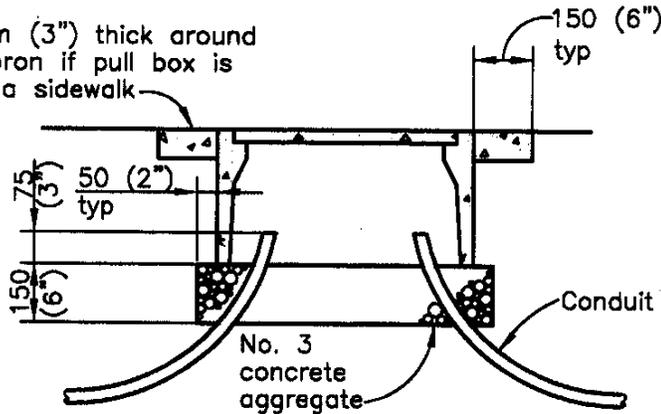

TYPICAL PULL BOX INSTALLATION

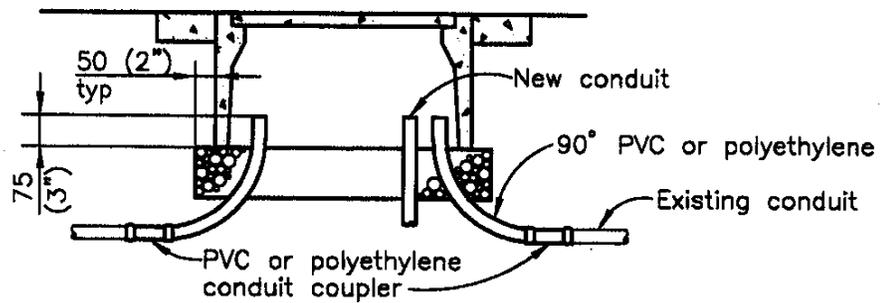

TYPICAL CONDUIT INTERCEPT

NOTE:

Size of coupler and new conduit shall be same size as existing conduit

Dimensions are in millimeters, except as noted

REVISIONS		CITY OF LONG BEACH, CALIFORNIA DEPARTMENT OF PUBLIC WORKS	STANDARD PLAN NO.
NO.	DATE		METRIC 708
1	01/21/98	APPROVED BY: <i>Mark Onizoff</i> CITY ENGINEER R.E. No. 40299	SHEET
2	12/23/02		1 OF 1
3			DATE: 1/10/03
4			EX. DATE: 03/31/03